

# Acoustics

# Measurement of sound insulation in buildings and of building elements

**Part 9: Laboratory measurement of  
room-to-room airborne sound  
insulation of a suspended ceiling with a  
plenum above it**

The European Standard EN 20140-9:1993 has the status of a  
British Standard

UDC 534.833.522.4.08

# Committees responsible for this British Standard

The preparation of this British Standard was entrusted by the Environment and Pollution Standards Committee (EPC/-) to Technical Committee EPC/1, upon which the following bodies were represented:

Association of Consulting Engineers  
 British Broadcasting Corporation  
 British Occupational Hygiene Society  
 British Telecommunications plc  
 Department of Health and Social Security  
 Department of the Environment (Building Research Establishment)  
 Department of Trade and Industry (Air Division)  
 Department of Trade and Industry (National Physical Laboratory)  
 Engineering Equipment and Materials Users Association  
 Health and Safety Executive  
 Incorporated Association of Architects and Surveyors  
 Institute of Acoustics  
 Institute of Occupational Hygienists  
 Institute of Physics  
 Institute of Sound and Vibration Research  
 Institution of Civil Engineers  
 Institution of Electronic and Radio Engineers  
 Petroleum Industry Association  
 Royal Institute of British Architects  
 Society of Environmental Engineers  
 Transmission and Distribution Association (BEAMA Limited)

The following bodies were also represented in the drafting of the standard, through subcommittees and panels:

Aggregate Concrete Block Association  
 Association of Building Component Manufacturers Ltd.  
 Autoclaved Aerated Concrete Products Association  
 Brick Development Association  
 British Ceramic Research Association  
 Calcium Silicate Brick Association Limited  
 Cement Makers Federation  
 Concrete Society  
 Gypsum Products Development Association  
 Heriot-Watt University  
 Hevac Association  
 National Brassfoundry Association  
 Structural Insulation Association  
 Suspended Ceilings Association  
 Timber Research and Development Association

## Amendments issued since publication

Amd. No.	Date of issue	Comments
7954	February 1994	Indicated by a sideline in the margin

This British Standard, having been prepared under the direction of the Environment and Pollution Standards Committee, was published under the authority of the Board of BSI and comes into effect on 27 February 1987

© BSI 08-1999

The following BSI references relate to the work on this standard:  
 Committee reference EPC/1  
 Draft for comment 83/51753 DC

ISBN 0 580 15639 7

---

---

# Contents

	Page
Committees responsible	Inside front cover
National foreword	ii
<hr/>	
Foreword	2
1 Scope and field of application	3
2 References	3
3 Definitions	3
4 Measuring equipment	4
5 Test arrangement	4
6 Test procedure and evaluation	5
7 Precision	5
8 Statement of results	6
9 Test report	6
<hr/>	
Annex Example of a test procedure	7
<hr/>	
Figure 1 Cross-section and plan of the test facility	8
<hr/>	
Table	4
<hr/>	
Publications referred to	Inside back cover
<hr/>	

# National foreword

This Part of BS 2750 has been prepared under the direction of the Environment and Pollution Standards Committee. It is identical with ISO 140-9:1985

*Acoustics Measurements of sound insulation in buildings and of building elements Part 9: Laboratory measurement of room-to-room airborne sound insulation of a suspended ceiling with a plenum above it*, published by the International Organization for Standardization (ISO). ISO 140-9 was prepared by subcommittee 2, Building acoustics, of ISO Technical Committee 43, Acoustics, with the active participation and approval of the UK. The aspects of sound insulation covered by ISO 140-9:1985 were not included in BS 2750:1956.

In 1993 the European Committee for Standardization (CEN) accepted ISO 140-9:1985 as European Standard EN 20140-9:1993. As a consequence of implementing the European Standard this British Standard is renumbered as BS EN 20140-9 and any reference to BS 2750-9 should be read as a reference to BS EN 20140-9.

The following Parts of BS 2750 have already been published.

*Part 1: Recommendations for laboratories;*

*Part 2: Statement of precision requirements;*

*Part 3: Laboratory measurements of airborne sound insulation of building elements;*

*Part 4: Field measurements of airborne sound insulation between rooms;*

*Part 5: Field measurements of airborne sound insulation of façade elements and façades;*

*Part 6: Laboratory measurements of impact sound insulation of floors;*

*Part 7: Field measurements of impact sound insulation of floors;*

*Part 8: Laboratory measurements of the reduction of transmitted impact noise by floor coverings on a standard floor.*

Further Parts of this British Standard will be prepared, if required.

**Terminology and conventions.** The text of the International Standard has been approved as suitable for publication as a British Standard without deviation. Some terminology and certain conventions are not identical with those used in British Standards; attention is drawn especially to the following.

The comma has been used as a decimal marker. In British Standards it is current practice to use a full point on the baseline as the decimal marker.

Wherever the words *part of ISO 140* appear, referring to this standard, they should be read as *Part of BS 2750*.

**Additional information.** It should be noted, in referring to the figure, that the dimensions stated are given by way of example only and are not intended to be limiting.

## Cross-references

International Standards	Corresponding British Standards
	BS 2750 <i>Methods of measurement of sound insulation in buildings and of building elements</i>
ISO 140-2:1978	Part 2:1980 <i>Statement of precision requirements</i> (Identical)
ISO 354:1985	BS 3638:1987 <i>Method for measurement of sound absorption in a reverberation room</i> (Identical)
ISO 717-1:1982	BS 5821 <i>Methods for rating the sound insulation in buildings and of building elements</i> Part 1:1984 <i>Method for rating the airborne sound insulation in buildings and for interior building elements</i> (Identical)

IEC 225:1966

BS 2475:1964 *Octave and one-third octave band-pass filters*

(Technically equivalent)

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

**Compliance with a British Standard does not of itself confer immunity from legal obligations.**

### **Summary of pages**

This document comprises a front cover, an inside front cover, pages i to iv, the EN title page, pages 2 to 8, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.



UDC 534.833.522.4.08

Descriptors: Acoustics, buildings, components, suspended ceilings, tests, acoustic tests, laboratory tests, determination, acoustic insulation, airborne sound

English version

Acoustics Measurement of sound insulation in  
buildings and of building elements Part 9: Laboratory  
measurement of room-to-room airborne sound insulation  
of a suspended ceiling with a plenum above it

(ISO 140-9:1985)

Acoustique Mesurage de l'isolation  
acoustique des immeubles et des éléments de  
construction  
Partie 9: Mesurage en laboratoire de l'isolation  
au bruit aérien de pièce à pièce par un plafond  
suspendu surmonté d'un vide d'air  
(ISO 140-9:1985)

Akustik Messung der Schalldämmung in  
Bauten und von Bauteilen  
Teil 9: Raum-zu-Raum-Messung der  
Luftschalldämmung von Unterdecken mit  
Darüberliegendem Hohlraum im Prüfstand  
(ISO 140-9:1985)

This European Standard was approved by CEN on 1993-09-21. CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

**CEN**

European Committee for Standardization  
Comité Européen de Normalisation  
Europäisches Komitee für Normung

Central Secretariat: rue de Stassart 36, B-1050 Brussels

**Foreword**

This European Standard is the endorsement of ISO 140-9. Endorsement of ISO 140-9 was recommended by CEN/TC 126 *Acoustic properties of building products and of buildings* under whose competence this European Standard will henceforth fall.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 1994, and conflicting national standards shall be withdrawn at the latest by March 1994.

The standard was approved and in accordance with the CEN/CENELEC Internal Regulations, the following countries are bound to implement this European Standard: Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland, United Kingdom.

## 1 Scope and field of application

This part of ISO 140 specifies a laboratory method of measuring the airborne sound insulation of a suspended ceiling with a plenum of defined height mounted above an acoustical barrier which separates two rooms of a specified test facility.

This method utilizes a laboratory space so arranged that it simulates a pair of horizontally adjacent, typical offices or rooms sharing a common suspended ceiling system, plenum space and a dividing wall. The dividing wall extends to the underside of the ceiling system which at the junction is either continuous or discontinuous.

The quantity being measured is the airborne sound insulation between two rooms of a specified test facility when the sound transmitted by paths other than the suspended ceiling and common plenum space is negligible. This quantity is called the suspended ceiling normalized level difference.

The method may be extended to include the study of composite ceiling systems comprising the ceiling material and other components such as luminaires and ventilating systems.

The method may also be extended to the study of the additional sound insulation that may be achieved by auxiliary systems, such as material used either as plenum barriers or as backing for all of, or part of, the ceiling.

## 2 References

ISO 140-2, *Acoustics Measurement of sound insulation in buildings and of building elements Part 2: Statement of precision requirements.*

ISO 354, *Acoustics Measurement of sound absorption in a reverberation room.*

ISO 717-1, *Acoustics Rating of sound insulation in buildings and of building elements Part 1: Airborne sound insulation in buildings and of interior building elements.*

IEC Publication 225, *Octave, half-octave and third-octave band filters intended for the analysis of sounds and vibrations.*

## 3 Definitions

For the purpose of this part of ISO 140, the following definitions apply.

### 3.1

#### average sound pressure level in a room

ten times the common logarithm of the ratio of the space and time average of the sound pressure squared to the square of the reference sound pressure, the space average being taken over the entire room with the exception of those parts where the direct radiation of a sound source or the near field of the boundaries (wall, etc.) is of significant influence. This quantity is denoted by  $L$  and is expressed in decibels

$$L = 10 \lg \frac{p_1^2 + p_2^2 + \dots + p_n^2}{np_0^2} \quad \dots(1)$$

where

$p_1, p_2, \dots, p_n$  are the r.m.s. sound pressures at  $n$  different positions in the room;

$p_0 = 20 \mu\text{Pa}$  is the reference sound pressure.

### 3.2 level difference

the difference in the space and time average sound pressure levels produced in two rooms by a sound source in one of the rooms. This quantity is denoted by  $D$  and is expressed in decibels

$$D = L_1 - L_2 \quad \dots(2)$$

where

$L_1$  is the average sound pressure level in the source room;

$L_2$  is the average sound pressure level in the receiving room.

### 3.3 suspended ceiling normalized level difference

the level difference corresponding to a reference value of absorption area in the receiving room. This quantity is denoted by  $D_{n,c}$  and is expressed in decibels

$$D_{n,c} = D - 10 \lg \frac{A}{A_0} \quad \dots(3)$$

where

$D$  is the level difference;

$A$  is the equivalent absorption area in the receiving room;

$A_0$  is the reference absorption area. (For the laboratory,  $A_0 = 10 \text{ m}^2$ .)

### 3.4 plenum space

the whole of the void above the suspended ceilings in both rooms in the test facility, disregarding any sound-absorbing material stuck to the walls or laid on the back of the suspended ceiling

## 4 Measuring equipment

The measuring equipment shall be suitable for meeting the requirements of clause 6.

## 5 Test arrangement

### 5.1 Requirements for the laboratory

The laboratory test facility is divided into two rooms of approximately equal volumes by a wall. The essential features of the test facility are specified in 5.1.1 to 5.1.6 and are shown schematically in the Figure.

#### 5.1.1 Construction of the test facility

The test facility shall be a rectangular parallelepiped. It is recommended that a vibration break be provided in the outer walls, floor and roof of the facility in order to ensure that flanking transmission by paths other than the suspended ceiling and common plenum space is negligible.

The level of the background noise shall be sufficiently low to permit a measurement of the sound transmitted from the source room, taking into consideration the power output of the source room and the isolating properties of the specimens for which the laboratory is intended. The reverberation time in each room shall be greater than 1 s at all one-third octave bands of measurement with no plenum lining and no test specimen in place.

NOTE For the purposes of determining the reverberation time of each room, a suitable impervious plenum barrier should be installed between the top of the dividing wall and the roof.

#### 5.1.2 Dimensions of the test facility

The width of the test facility shall be  $4,5 \pm 0,5$  m and the height from the ground to the underside of the face of the suspended ceiling shall be  $2,8 \pm 0,2$  m when all dimensions are measured internally.

The volume  $V$  of each room shall be at least  $50 \text{ m}^3$  and the dividing wall shall be positioned such that the two room volumes differ by at least 10 % when the suspended ceiling is in position.

NOTE 1 It is realized that existing facilities may have room volumes less than  $50 \text{ m}^3$ , as low as  $40 \text{ m}^3$ . Such facilities will be allowable in accordance with this part of ISO 140 in cases where diffusing elements are used.

NOTE 2 The requirements and recommendations, as stated above, are intended to improve reproducibility between measurements made by different organizations on similar materials.

### 5.1.3 Dividing wall

The dividing wall is the acoustical barrier which divides the test facility below the suspended ceiling into two rooms. The wall shall be tapered at its upper extremity so that its overall thickness at the capping is not greater than 100 mm. The tapering between the widest part of the wall and the capping shall be achieved by means of an angle not exceeding  $30^\circ$  from the vertical. The construction of the dividing wall shall be of such materials that its sound insulation is 10 dB more than that of any ceiling which is likely to be tested.

NOTE For checking the sound insulation of the facility, a suitable plenum barrier of construction similar to the dividing wall can be installed between the top of the dividing wall and the roof.

#### 5.1.4 Plenum depth

The plenum depth shall be between 650 and 760 mm as measured from the upper face of the suspended ceiling to the underside of the roof of the test facility.

#### 5.1.5 Plenum lining

One sidewall and both endwalls of the plenum shall be lined with suitable sound-absorbing material. This material shall have such properties that when tested as a plane absorber in accordance with ISO 354, it has sound absorption coefficients not less than those shown in the Table.

Table

Centre frequency Hz	125	250	500	1 000	2 000	4 000
Sound absorption coefficient, $\alpha_s$	0,65	0,80	0,80	0,80	0,80	0,80

For the other sidewall and the roof, the sound absorption coefficient shall be less than 0,10 at all frequencies given in the Table.

For practical purposes, the thickness of the lining shall not exceed 150 mm.

#### 5.1.6 Diffusers

If necessary, diffusing elements may be installed in the rooms so as to improve the diffusion conditions.

### 5.2 Installation of the test ceiling

The detail of joining the ceiling to the top of the dividing wall is of critical importance and care shall be taken to simulate actual field conditions.

The area of a continuous ceiling shall be equal to the area given by the length and width of the test facility.

For a discontinuous ceiling, it may be necessary to add additional capping to the top of the dividing wall to complete the junction. The area of a discontinuous ceiling shall then be equal to the area given by the length and width of the test facility less the area of the capping on the top of the dividing wall.

The ceiling components shall be representative of those used in practice in actual field installations. The ceiling shall be installed in accordance with the recommended practice of the manufacturer or with the recommended practice of an installation standard.

## 6 Test procedure and evaluation

### 6.1 Generation of sound field in the source room

The sound generated in the source room shall be steady and shall have a continuous spectrum in the frequency range considered. Filters with a bandwidth of at least one-third octave shall be used. The sound power shall be sufficiently high for the sound pressure level in the receiving room to be at least 10 dB higher than the background level in any frequency band.

If the sound source contains more than one loudspeaker operating simultaneously, the loudspeakers shall be contained in one enclosure, the maximum dimension of which shall not exceed 0,7 m. The loudspeakers shall be driven in phase.

The loudspeaker enclosure shall be placed in each room to give as diffuse a sound field as possible and at such a distance from the suspended ceiling that the direct radiation upon it is not dominant.

### 6.2 Measurement of the average sound pressure level

The average sound pressure level is obtained by using a number of fixed microphone positions or a continuously moving microphone with an integration of  $p^2$ .

### 6.3 Frequency range of measurements

The sound pressure level shall be measured using one-third octave band filters. The discrimination characteristics of the filters shall be in accordance with IEC Publication 225.

One-third octave band filters having at least the following centre frequencies, in hertz, shall be used:

100, 125, 160, 200, 250, 315, 400, 500, 630, 800,  
1 000, 1 250, 1 600, 2 000, 2 500, 3 150

### 6.4 Measurement and evaluation of the equivalent absorption area

The correction term of equation (3) containing the equivalent absorption area shall be evaluated from the reverberation time measured in accordance with ISO 354 using the following formula:

$$A = \frac{0,163 V}{T} \quad \dots(4)$$

where

- $A$  is the equivalent absorption area, in square metres;
- $V$  is the receiving room volume, in cubic metres, with the test ceiling in place;
- $T$  is the reverberation time of the receiving room, in seconds.

### 6.5 Measurement procedure

Each organization shall determine a normal test procedure which complies with this part of ISO 140. The necessary criteria which affect the repeatability of the measurements are shown below:

- number, type and size of diffusing elements (if any);
- position of the sound source;
- minimum distances between microphone and sound source and microphone and room boundaries with regard to near fields;
- number of microphone positions or, in the case of a moving microphone, the microphone path;
- averaging time of the sound pressure levels;
- method for determining the equivalent absorption area, which involves a number of repeated readings in each position.

An example of typical test conditions is given in the Annex.

### 6.6 Evaluation of suspended ceiling normalized level difference

The test procedure shall be repeated reversing the source and receiving rooms. The reported value of  $D_{n,c}$  shall be the arithmetic average of the two results.

## 7 Precision

It is required that the measurement procedure should give satisfactory repeatability. For the instrumentation and, in specific cases, for the complete measurement condition, this can be determined in accordance with the method described in ISO 140-2.

It is recommended that different organizations in the same country should periodically perform comparison measurements on the same test specimen to check repeatability and reproducibility of their test procedures.

## 8 Statement of results

For the statement of results, the suspended ceiling normalized level difference of the test specimen shall be given at all frequencies of measurement, in tabular form and/or in the form of a curve. For graphs with the level in decibels plotted against frequency on a logarithmic scale, the length for 10 : 1 frequency ratio shall be equal to the length for 10 dB, 25 dB or 50 dB on the ordinate scale.

## 9 Test report

The test report shall make reference to this part of ISO 140 and shall include the following information:

- a) the name of organization which performed the measurements;
- b) the date of test;
- c) a detailed description of the suspended ceiling tested, with sectional drawing and mounting conditions, including size, thickness, mass per unit area, number of suspension hangers and whether the ceiling is continuous or discontinuous at the partition capping, together with details of any luminaires, ventilating elements or other openings;
- d) the ceiling test material, for example, acoustic tile. This information shall include the origin of manufacture and the manufacturer's descriptive code number;
- e) the dimensions of the rooms used, including volume of rooms and plenum height of test facility;
- f) the cross-sectional area above the dividing wall and construction of the plenum barrier (see 5.3) (if any);
- g) the specification (and thickness) of any materials used in the plenum either as a barrier or a lining on the back of the specimen (or both);
- h) a description of the junction of the dividing wall and the ceiling;
- j) the type of noise and of filters used;
- k) a brief description of details of test procedure and equipment (see 6.5);
- m) the suspended ceiling normalized level difference as a function of frequency;
- n) the equivalent sound absorption area measured in both rooms as function of frequency;

p) the limit of measurement in cases where the sound pressure level in any band is not measurable on account of background noise (acoustical or electrical).

For the evaluation of a single-number quantity from the curve  $D_{n,c}(f)$ , see ISO 717-1. This quantity is called the weighted suspended ceiling normalized level and is denoted by  $D_{n,c,w}$ .

## Annex Example of a test procedure

(This annex does not form an integral part of the standard.)


An example of a test procedure which will normally be expected to give repeatability as indicated in ISO 140-2 is given below.

The dimensions and shape of the test facility are shown in the Figure. The walls, floor and roof of this structure are preferably constructed from heavy masonry.

The measurement is carried out in both directions with a loudspeaker installed in each room during the entire test. The suspended ceiling normalized level difference is measured separately for each direction of test; the value reported is the arithmetic average of the two results.

The loudspeaker is placed facing one corner of each room and the sound field in each room sampled with six randomly distributed microphone positions. No microphone is placed closer than 0,7 m to any surface and microphone positions are separated by a distance of at least 0,5 m. Sound pressure level readings are taken at each microphone position using an averaging time of at least 5 s in each frequency band at each position. One-third octave band filters are used.

The equivalent absorption area is determined from decay curves measured using six microphone positions with one reverberation time analysis at each position. The reverberation time is evaluated from the averaged slope over a convenient range beginning about one-tenth of a second or a few decibels down from the beginning of the decay, the range used being at least 20 dB, but not so large that the slope changes by 20 %, nor so that background noise interferes with the results.

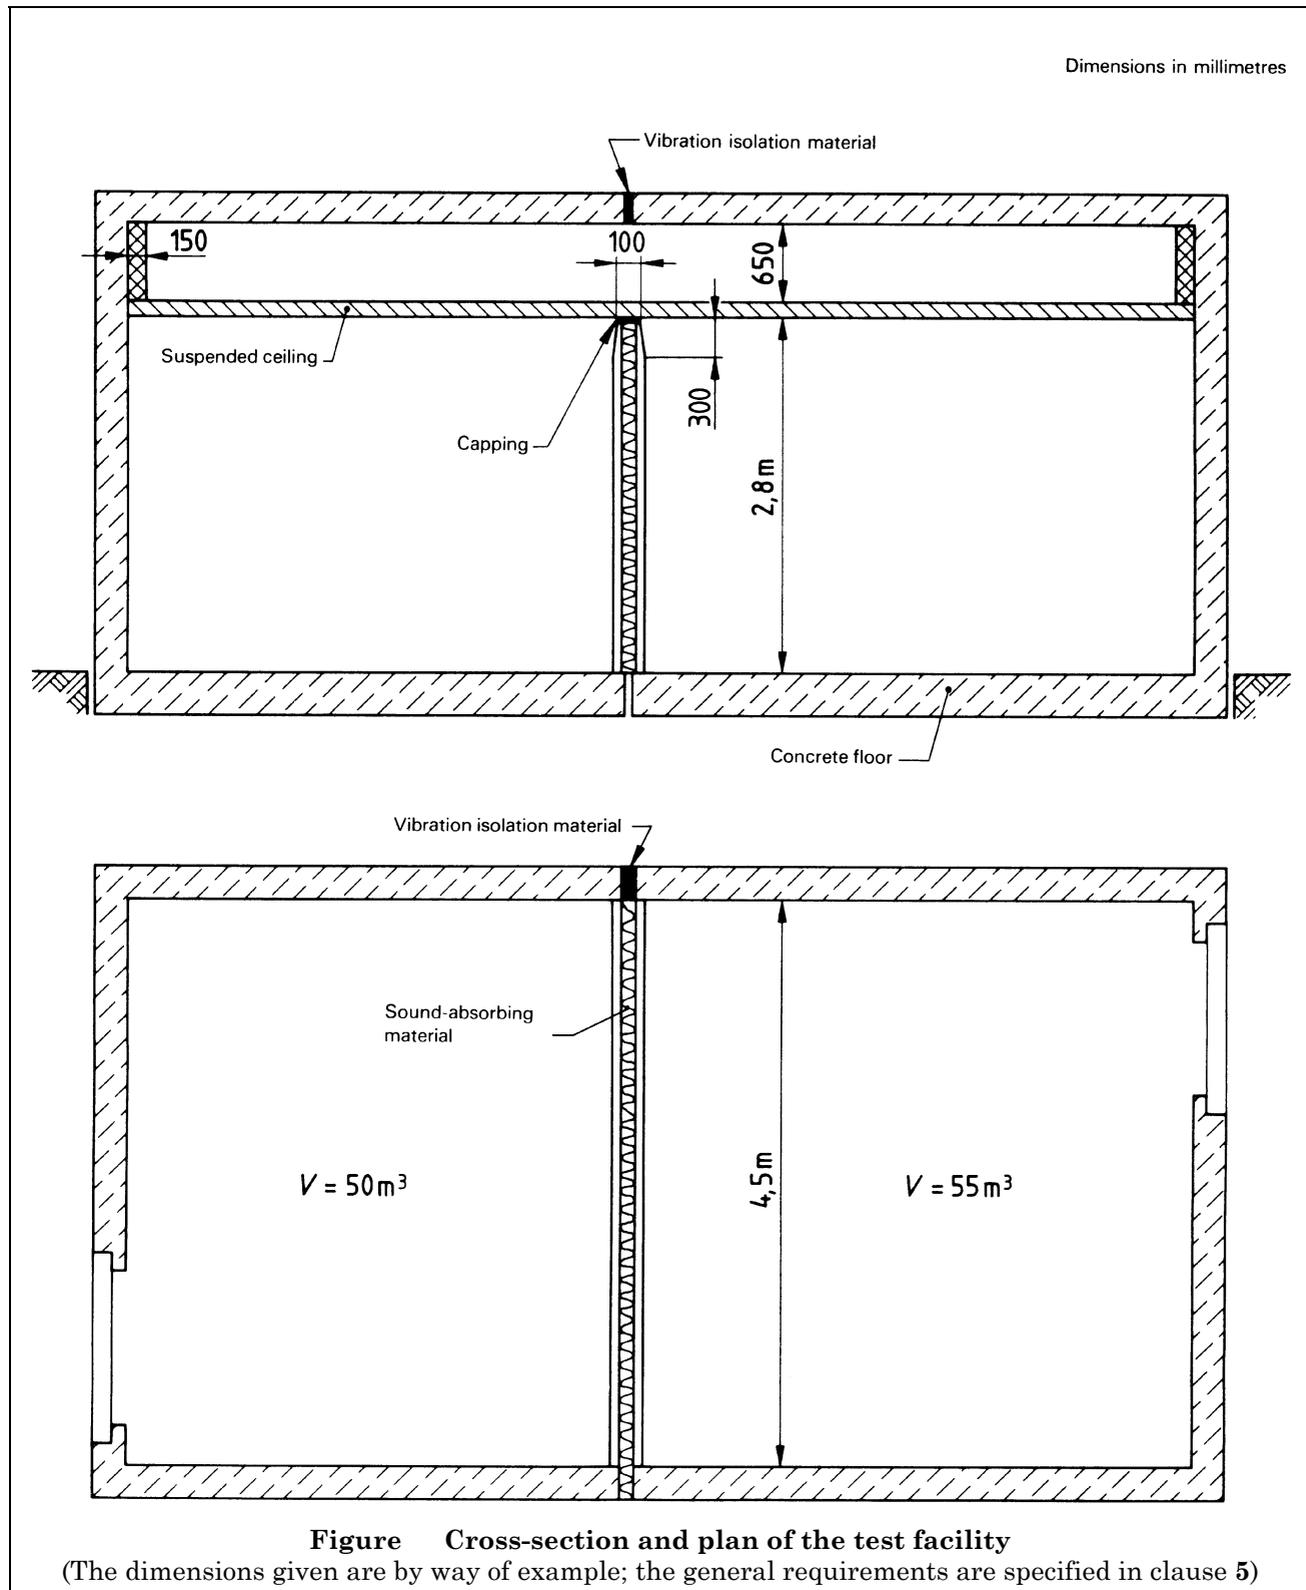

**Figure Cross-section and plan of the test facility**

(The dimensions given are by way of example; the general requirements are specified in clause 5)

## **Publications referred to**

See national foreword.

**BS EN**  
**20140-9:1994**  
**BS 2750-9:**  
**1987**  
**ISO 140-9:**  
**1985**

---

---

## **BSI British Standards Institution**

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### **Revisions**

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: 020 8996 9000. Fax: 020 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### **Buying standards**

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: 020 8996 9001. Fax: 020 8996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### **Information on standards**

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: 020 8996 7111. Fax: 020 8996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: 020 8996 7002. Fax: 020 8996 7001.

### **Copyright**

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means electronic, photocopying, recording or otherwise without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager. Tel: 020 8996 7070.

---

BSI  
389 Chiswick High Road  
London  
W4 4AL